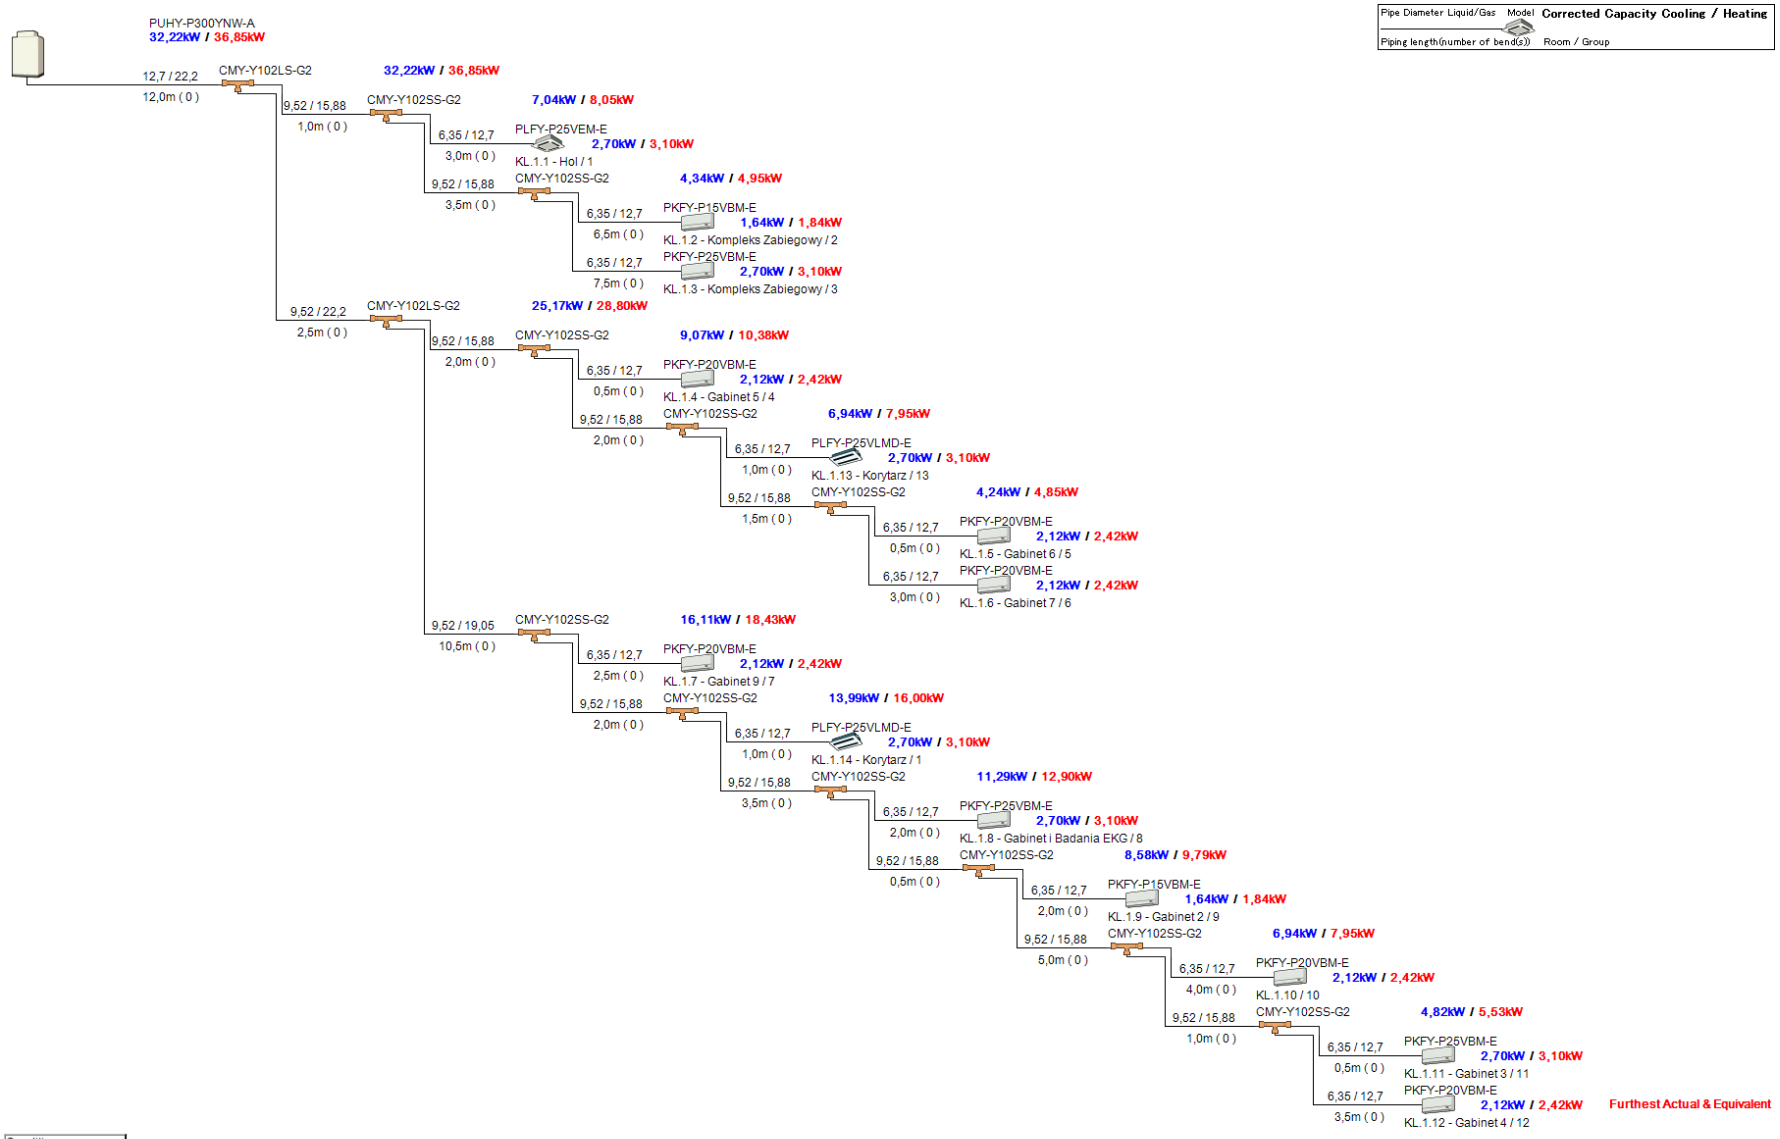


| Condition | |
|---|---|
| Cooling | |
| Indoor DB | 27,0 ℃ |
| Humidity | 47 % |
| Indoor WB | 19,0 ℃ |
| Outdoor DB | 35,0 ℃ |
| Heating | |
| Indoor DB | 20,0 ℃ |
| Outdoor DB | 7,0 ℃ |
| Humidity | 87 % |
| Outdoor WB | 6,0 ℃ |